

# CERTIFICATE

No: 000209/02

In accordance with the **CertAlarm** Rules and Certification scheme type 5, as defined in ISO/IEC 17067, we Telefication B.V. certify that the product

**HS2LCDP**

is in conformity with the following standard(s)

**EN 50131-3**

Alarm systems - Intrusion and hold-up systems - Part 3: Control and indicating equipment

**Digital Security Controls, a div. of Tyco Safety Products Canada Ltd.**  
3301 Langstaff Road  
L4K 4L2 CONCORD  
Canada

is authorised to use the CERTALARM Mark on the above mentioned product.  
This certificate is valid until:  
19 December 2022

Zevenaar, 21 December 2018

Signed on behalf of Telefication B.V.



Jan Willem Verwoert  
Project Manager



# CERTIFICATE

No: 000209/02 - Annex No 1

## Takes into account the following product and variants:

- Product description: I&HAS LCD Keypad  
- Trademark: DSC/Tyco  
- Type designation: HS2LCDP  
- Hardware version: UA628 Rev. 03  
- Software version: Ver 1.3

- Product description: LCD Keypad  
- Trademark: DSC/Tyco  
- Type designation: HS2LCD  
- Hardware version: UA628 Rev. 03  
- Software version: Ver 1.3

- Product description: LCD Keypad  
- Trademark: DSC/Tyco  
- Type designation: HS2ICNP  
- Hardware version: UA628 Rev. 03  
- Software version: Ver 1.3

- Product description: LCD Keypad  
- Trademark: DSC/Tyco  
- Type designation: HS2ICN  
- Hardware version: UA628 Rev. 03  
- Software version: Ver 1.3

## The optional features of the specifications that are included in the product and test report:

Security grade: 2 (HS2ICNP; HS2ICN)  
Security grade: 3 (HS2LCDP; HS2LCD)  
Environmental class: II  
Equipment class: Fixed

This equipment can be applied in EN 50131-1 compliant systems up to and including security grade 2 for HS2ICNP; HS2ICN and grade 3 for HS2LCDP; HS2LCD.

Factory location:  
Digital Security Controls, a div. of Tyco Safety Products Canada Ltd.  
95 Bridgeland Ave.  
M6A1Y7 Toronto  
Canada

Storage location:  
AnB Rimex SA

# CERTIFICATE

No: 000209/02 - Annex No 1


Telefication B.V.  
Edisonstraat 12A  
6902 PK Zevenaar  
Phone : +31 316 583 180  
Fax : +31 316 583 189  
E-mail: certification@telefication.com  
Web: www.telefication.com

Rue de l'Abbaye 89  
4040 Herstal  
Belgium

-

## Test Reports:

- Nemko Canada Inc.: 238276-1R1TRFEMC, 09 January 2014
- Telefication B.V.: 20134025800 -Ver2.00, 27 January 2015
- Telefication: 180600139-001-Ver.2.00, 21 December 2018

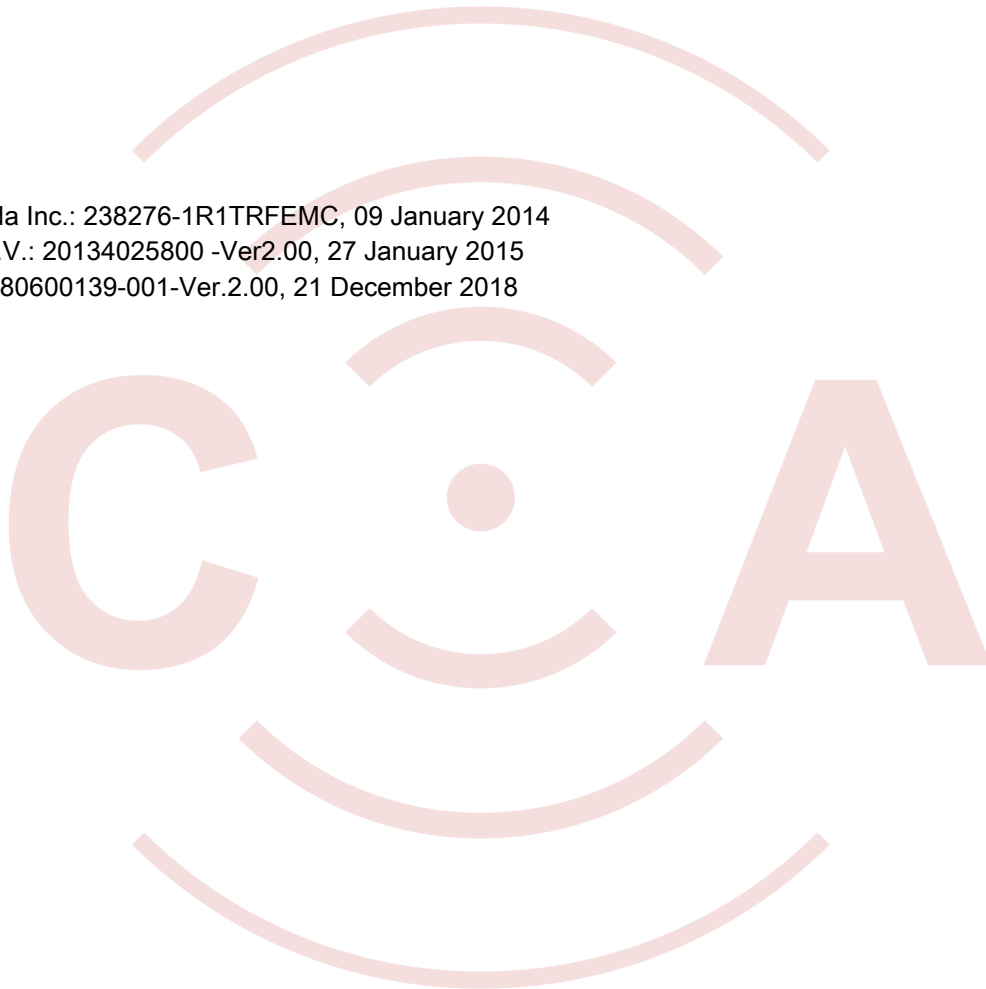

# CERTIFICATE

No: 000209/02 - Annex No 2

## Validity of Certificate:

The Certificate remains valid based upon satisfactory annual factory production control audits for Fire products or biennial factory production control audits for Security products and follow up re-testing as required by CertAlarm scheme rules.

## Documents submitted:

- Assembly drawings
- Bill of material / Parts list
- Electronic schematics
- Manual
- Internal / external photos
- Label and label placement
- RF\_071\_02 Request for prolongation of an Alarm Certificate - HS2LCDP\_HS2...
- Keypads SW (1\_3) statement for Telefication - 09272017

## DISCLAIMER:

The validity of this certificate is limited to products, which are equal to the one(s) examined.